

Issue Date: 02-10-2022  
Revised Date: 08-11-2023  
Renewal Date: 02-28-2024

**DIVISION: 07 00 00 – THERMAL AND MOISTURE PROTECTION**

**Section: 07 41 13 – Metal Roof Panels**

**REPORT HOLDER:**

**TEK Industries LLC**  
11801 Pierce Street, Suite 200  
Riverside, CA 92505  
877-729-5229  
[www.tekroofingsystems.com](http://www.tekroofingsystems.com)

**REPORT SUBJECT:**

**Hurricane Metal Shake**  
**Hurricane Metal Shake PRO**

### 1.0 SCOPE OF EVALUATION

**1.1** This Research Report addresses compliance with the following Codes:

- 2021 and 2018 *International Building Code*® (IBC)
- 2021 and 2018 *International Residential Code*® (IRC)
- 2022 *California Building Code* (see Section 9.0)
- 2023 and 2020 *Florida Building Code* (see Section 9.0)

NOTE: This report references the most recent Code editions cited. Section numbers in earlier editions may differ.

**1.2** The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels have been evaluated for the following properties (see Table 1):

- Physical properties
- Wind resistance
- Fire classification

**1.3** The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels have been evaluated for the following uses (see Table 1):

- Metal roof panels complying with the requirements of IBC Section 1507.4 and IRC Section R905.10.
- Use as roof panels on buildings requiring a Class A roof classification

### 2.0 STATEMENT OF COMPLIANCE

The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels complies with the Codes listed in Section 1.1, for the properties stated in Section 1.2 and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.

### 3.0 DESCRIPTION

**3.1 Roof Panels:** The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels are No. 28 gage AZ30 Galvalume coated steel, covered with a proprietary coating. The panels are 53 inches long and 13 inches tall. See Figures 1 and 2 for panel profiles.

### 4.0 PERFORMANCE CHARACTERISTICS

**4.1 Fire Classification:** The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels have a Class A rating when tested in accordance with ASTM E108 (UL 723). See Table 2 for roof assembly details.

**4.2 Wind Uplift Resistance:** Maximum allowable design pressures are shown in Table 3, based on testing in accordance with UL 1897, ASTM E1592 and TAS 125. Values are based on the allowable stress design (ASD) and include safety factors specified in ICC-ES AC166.

**4.3 Impact Resistance:** The panels meet the Class 4 impact requirements of UL 2218. Note, impact resistance is not required by the codes for roofing installed at slopes greater than 2:12.

### 5.0 INSTALLATION

#### 5.1 General:

The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels must be installed in accordance with the manufacturer's published installation instructions, the applicable Code, and this Research Report. A copy of the



manufacturer's instructions must be available on the jobsite during installation.

## 5.2 Application:

The roof panels must be installed on roofs having a minimum slope of 3:12 per IBC Section 1507.4.2 and IRC Section R905.10.2. The roof panels are attached directly to the roof deck consisting of minimum 15/32-in. exterior grade plywood complying with APA PS-1. Construction of the roof covering must be as described in Tables 2 and 3.

## 6.0 CONDITIONS OF USE

**6.1** Installation must comply with this Research Report, the manufacturer's published installation instructions, and the applicable Code. In the event of a conflict, this report governs.

**6.2** The allowable wind uplift resistance noted in Table 3 is for the metal panels only. The roof deck and framing to which the metal panels are attached must be designed for components and claddings in accordance with IBC Section 1609 and IRC Section R301.2.1.

**6.3** The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels are manufactured under a quality control program with inspections by Intertek Testing Services NA, Inc.

## 7.0 SUPPORTING EVIDENCE

**7.1** Reports of tests in accordance with ASTM E108-18b, UL 1897-15, ASTM E1592-05 (2017), UL 580, ASTM G155, ASTM B117 and TAS 125.

**7.2** Data in accordance with the ICC-ES Acceptance Criteria for Metal Roof Coverings (AC166), dated February 2021.

**7.3** Intertek Listing Report "TEK Industries LLC Hurricane Metal Roofing Panels", on the [Intertek Directory of Building Products](#).

## 8.0 IDENTIFICATION

The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels are identified with the manufacturer's name (Tek Industries LLC), the product name, the Intertek Mark as shown below, the Intertek Control Number and the Code Compliance Research Report number (CCRR-0443).



## 9.0 OTHER CODES

### 9.1 California Building Codes

The Hurricane Metal Shake and Hurricane Metal Shake PRO roofing panels described in Sections 2.0 through 7.0 of this Research Report, comply with the 2022 California Building Code and California Residential Code.

### 9.2 Florida Building Codes

The Hurricane Metal Shake and hurricane Metal Shake PRO roofing panels described in Sections 2.0 through 7.0 of this report, comply with the 2023 and 2020 Florida Building Code-Building and Residential, excluding High Velocity Hurricane Zones, subject to the following conditions:

- Fasteners shall comply with FBC-Building Sections 1606.5 and 1506.6, and FBC-Residential Sections R904.5.1 and R904.5.2, as applicable.
- Underlayment shall comply with FBC-Building Section 1507.1.1.1 and FBC-Residential Section R905.1.1.

This Code Compliance Research Report ("Report") is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005  
[intertek.com/building](http://intertek.com/building)





- Allowable wind uplift loads are based on a factor of 2 in accordance with FBC Section 1504.9.

Intertek is an approved evaluation entity and quality assurance entity pursuant to Florida Statute 553.842 – *Product Evaluation and Approval*.

#### 10.0 CODE COMPLIANCE RESEARCH REPORT USE

**10.1** Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

**10.2** Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

**10.3** Reference to the <https://bpdirectory.intertek.com> is recommended to ascertain the current version and status of this report.





TABLE 1 - PROPERTIES EVALUATED

PROPERTY	2021 IBC SECTION	2021 IRC SECTION	2023 FBC Section	2023 CBC Section
Physical properties	1507.4	R905.10	1507.4.3	1507.4
Fire classification	1505	R902	1505	1505
Wind resistance	1504.4.3	R905.4.4.1	1504.3.2	1504.4.3

Referenced sections apply to the latest Code editions referenced in Section 1.0 of this report

TABLE 2 – FIRE CLASSIFICATION

Min. Roof Slope	Roof Deck	Underlayment	Metal Panel	Roof Classification
Min. - 3:12 Max. - unlimited	15/32-in. exterior grade plywood	1 layer of synthetic roofing underlayment certified to ICC-ES AC188, and 1 layer of GAF VersaShield (ESR-2053)	Hurricane Metal Shake or Hurricane Metal Shake PRO	Class A

TABLE 3 – WIND UPLIFT RESISTANCE AND CONSTRUCTION DETAILS

Metal Panel	System Configuration	Allowable Wind Resistance <sup>1</sup> (psf)
Hurricane Metal Shake	Panels attached to min. 15/32-in. plywood with eight, min. #10-12 x 2-1/2 in. HWH wood screws, four screws in the top flange, spaced 2 in. from ends and 16 in. oc. Screws engage the lower flange of the course above.	55
Hurricane Metal Shake	Back flange attached to min. 15/32-in. plywood roof deck through a foam insulation wedge with 0.120" x 3" ring shank nails at 6" oc. The front flange attached through the back flange of the panel in the course below, and into the roof deck, with #10-12 x 2-1/2" HWH wood screws at 6" oc. See Figure 3 (Method 1). <sup>2</sup>	124
Hurricane Metal Shake	Front and back flanges attached to nominal 2 x 2 wood battens with 0.131" x 2-3/8" ring shank nails at 6" oc. Battens are minimum s.g. of 0.42, attached to min. 15/32-in. plywood with 0.120-in. x 3-in. ring shank nails at 6-in. oc. A foam insulation wedge is loose laid under the tile next to the batten. See Figure 4 (Method 2).	116
Hurricane Metal Shake	Front and back flanges attached to nominal 2 x 2 wood battens with #10 x 1-1/2" screws at 6" oc. Battens are minimum s.g. of 0.42, attached to min. 15/32-in. plywood with 0.120-in. x 3-in. ring shank nails at 6-in. oc. A foam insulation wedge is loose laid under the tile next to the batten. See Figure 5 (Method 3). <sup>2</sup>	86
Hurricane Metal Shake PRO	Panels attached to min. 15/32-in. plywood with six, min. #10-12 x 2-1/2 in. HWH wood screws, located in the nailing flange, 2 in. from ends and 10 in. oc. The panels interlock with the panels in the next course.	90
Hurricane Metal Shake PRO	Panels attached to min. 15/32-in. plywood with eight, min. #10 x 2-1/2-in HWH wood screws, located in the nailing flange, 2 in. from ends and 6-3/4-oc for the field of the roof AND ten, min. #10 x 2-1/2-in. HWH wood screws, located in the nailing flange, 2 in. from ends and 5-1/4-in. oc, in the corners.	101

<sup>1</sup>Allowable loads are based on a factor of 2 applied to the ultimate tested load.

<sup>2</sup>Foam insulation wedge shall be of materials complying with IBC and FBC Section 2603 and IRC and FBC – Residential Section 316.



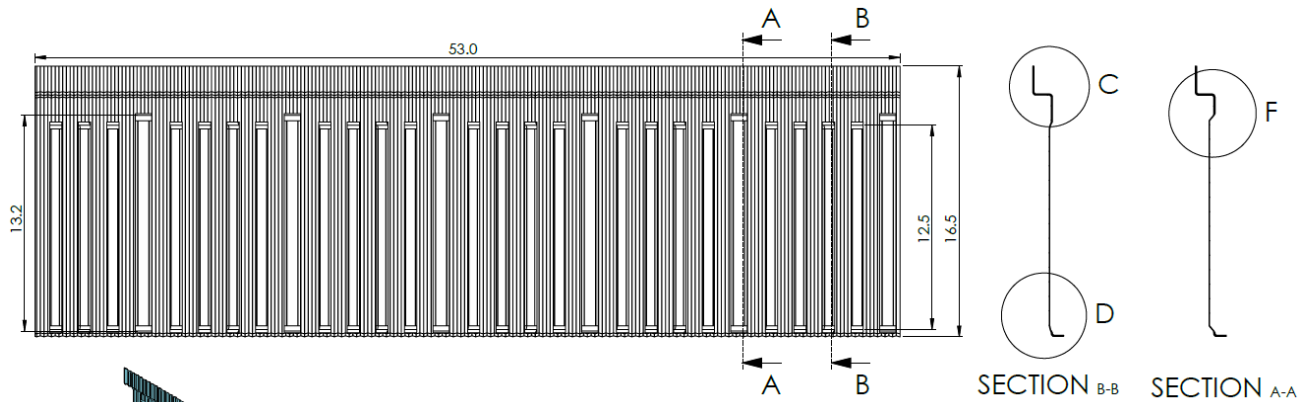


Figure 1 – Hurricane Metal Shake

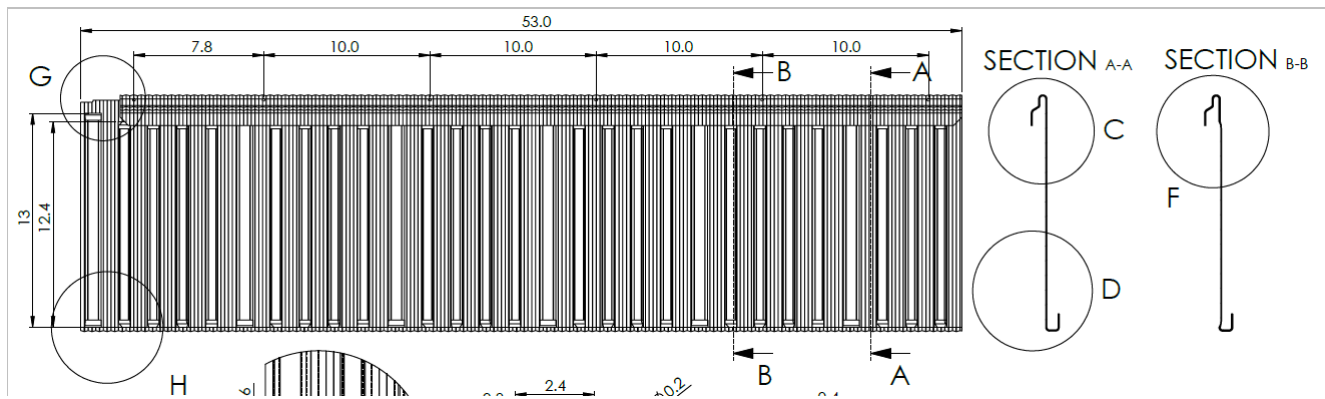


Figure 2 – Hurricane Metal Shake PRO



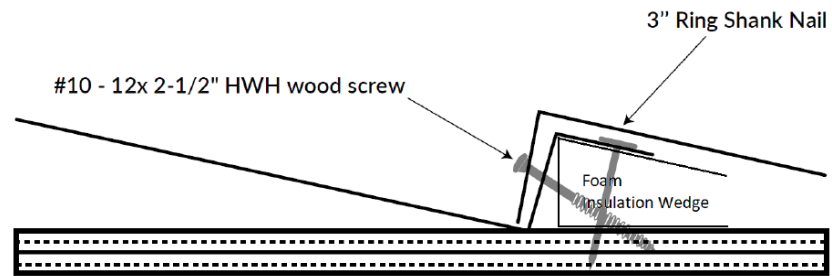


Figure 3 – Attachment Method 1 – Hurricane Metal Shake

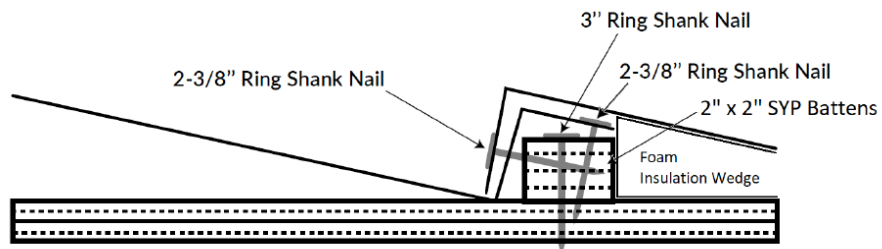


Figure 4 – Attachment Method 2 – Hurricane Metal Shake

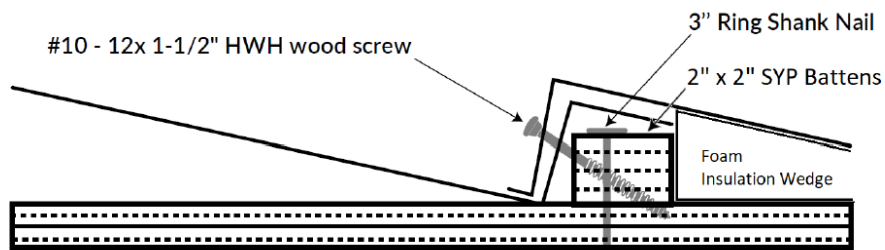


Figure 5 – Attachment Method 3 – Hurricane Metal Shake